# MRL Passenger Elevator

| Hoistway Structure | | |
|---|---|---|
| Concrete ☐ | Brick & Concrete ☐ | Other _____ |

☐ Unstandard ☑ Standard

| NOTE | | | |
|---|---|---|---|
| HW | HOISTWAY WIDTH | CW | CAR INSIDE WIDTH |
| HD | HOISTWAY DEPTH | CD | CAR INSIDE DEPTH |
| OP | DOOR OPENING WIDTH | CH | CAR HEIGHT |
| ROP | WALL OPENING WIDTH | MRW | MACHINE ROOM WIDTH |
| OPH | DOOR OPENING HEIGHT | MRD | MACHINE ROOM DEPTH |
| OH | OVERHEAD HEIGHT | MRH | MACHINE ROOM HEIGHT |
| CAR DBG | DISTANCE BETWEEN CAR GUIDE RAILS | | |
| CWT DBG | DISTANCE BETWEEN COUNTERWEIGHT GUIDE RAILS | | |

| Technical Requirement： | | | |
|---|---|---|---|
| type | TKJW 800 / 1.0 -VF | | |
| F/P/D | / / | Door type | Center open |
| load | 800 kg | speed | 1.0 m/s |
| Machine | MCK200 | Roping | 2:1 |
| T/sheave | ø 400 | D/sheave | ø |
| car sheave | ø 440 | CW sheave | ø 400 |
| Shaft | HW 2300 mm x HD 2000 mm | | |
| Cabin | CW 1400 mm x CD 1350mm | | |
| Door | OP 800 mm x OPH 2100mm | | |

| Speed | 1.0 | 1.5 | 1.75 | (m/s) |
|---|---|---|---|---|
| Power | 5.4 | 8.1 | 9.4 | (kw) |
| OH | ⩾4300 | ⩾4400 | ⩾4400 | (mm) |
| Pit | ⩾1600 | ⩾1700 | ⩾1700 | (mm) |
| current | | | | (A) |

380V 3phase 5wire，50Hz，fluctuation ±7%

| Support Force (N) | | | | | | | |
|---|---|---|---|---|---|---|---|
| R1 | R2 | R3 | R4 | P1 | P2 | P3 | P4 |
| 27900 | 27100 | | | 72800 | 56000 | | |




The hook




Overhead plan/1:60




E/reserved hole/1：60

Bottom box Lop: 100x500 (base station) 100x400 (remaining stations)
No bottom box Lop hole: Ø50 hole

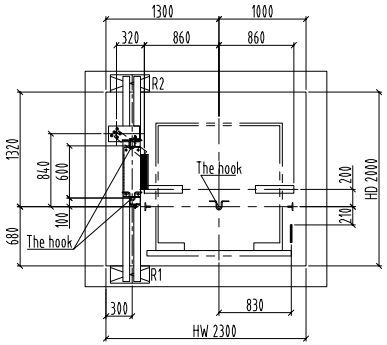


ELEVATION /1:60

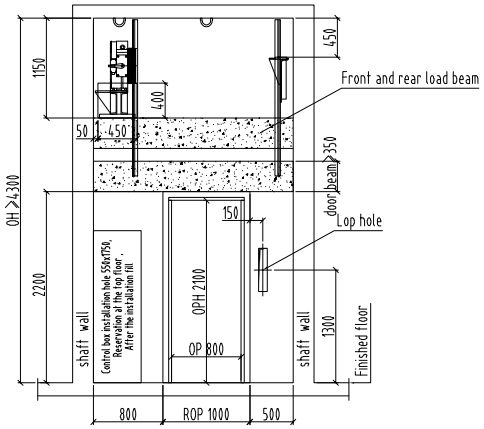


Hoistway plan/1:60

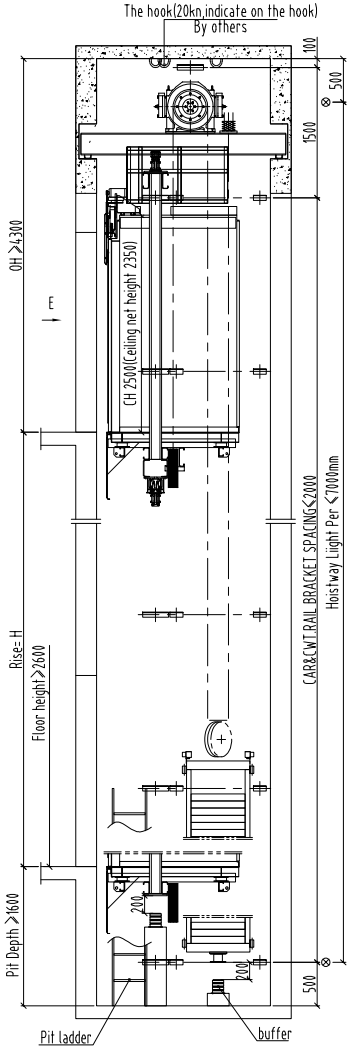


Pit plan/1：60

## Technical Requirment

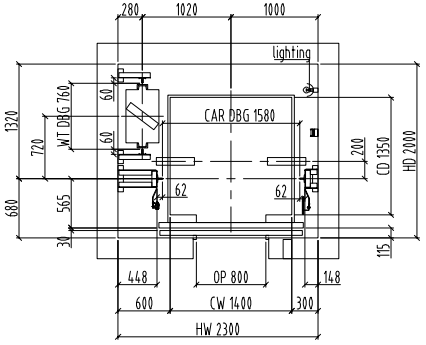1. Power supply: machine room need equiped with power supply. Power supply box need be locked. Power supply should be 3P,5 wires,380v 50Hz. Voltage tolerence ±7%;imput power more than 50% of motor power;also equiped with air switch same capacity with power supply,also allow the supplement leakage protector. When use VVVF,need use special leakage switch. Ground resistor should be< 4Ω.It should use insulated conductor from floor to machine room. Keep sepearte for null wire and ground wire.
2. Shaft requirement,it should be only for lift, can not install non-related device(pipe,cable etc),and should keep the person entre info. The shaft plan size mean the min.size measured by plumb line,tolerence ~+50mm. Basically not allow the protruding beam and column. The proof pressure of shaft side should be ⩾24MPa. Recommend to use full concrete,can not use the reserved steel. In case use solid brick,it should use reserved steel or make the ring beam on the surface of reserved steel,hight⩾300mm. If use hollow brick,can choose C25 concrete fill into the wall. also make the ring beam on the surface of reserved steel,hight ⩾300mm. If the shaft front wall is brick construction,it should make the concrete beam upsid of door hole to fix the landing door bracket,height ⩾300mm. If have the requirement in the drawing,it should make the concrete in the entrence of hall door. It should equiped with lamp,brightness ⩾ 50LX,install the lamp at 0.5m from the top and the bottom, in the middle,each lamp at <7m. The buffer block shouled be made accompany with special person. before that,need make the reserved ⩾4 pcs joint bar,⩾ø12mm,height ⩾500mm from the pit floor. and should water proof. Keep the space for person entrance. Pit ladder is by user. Should installed it in a suitbale place if there have basement downside of the pit,should make the buffer block extend to the solid floor downside. If the floor distance beteen 2 fllor ⩾11m,should set the safe door with the width 350mm,hight1800mm.
3. Machine room requiremnt(not for MRL),It had the passageway for the traction machine,
keep the entrance unblocked. the door opens outward, also can be locked.
Installed the fan,keep the humidity <85%,temperature +5℃~ 40℃,surrounding the reserved hole
should make the 50mm hole,keep the floor plan,also bear the load 700kg/m².
The motor beam should be supported in the concrete block,this concrete block should
extend to the building beam or bearing wall. Bearing side should make the reserved same side steel,
thickness 2mm,,bearing side thickness should over the wall thickness 20mm,total thickness more than 75mm.
Standard wall 200mm,recommed the bearing wall thickness ⩾200mm.
The hook in the machine room should indicate the max. load. It should install t
he ladder and barrier in case have stair.

| OH | ⩾4300 |
|---|---|
| Rise | H |
| | |
| | |
| | |
| | |
| 26 F | |
| 25 F | |
| 24 F | |
| 23 F | |
| 22 F | |
| 21 F | |
| 20 F | |
| 19 F | |
| 18 F | |
| 17 F | |
| 16 F | |
| 15 F | |
| 14 F | |
| 13 F | |
| 12 F | |
| 11 F | |
| 10 F | |
| 9 F | |
| 8 F | |
| 7 F | |
| 6 F | |
| 5 F | |
| 4 F | |
| 3 F | |
| 2 F | |
| 1 F | |
| G F | |
| B F | |
| Pit | ⩾1600 |
| Floor | Height |
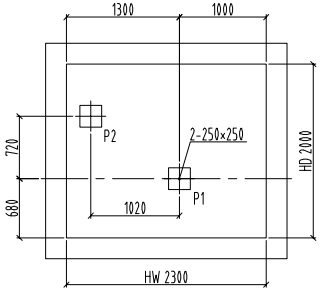
| Drawing | | approver | |
|---|---|---|---|
| Drawing No. | 800 | | |
| manufacturing no. | | | |
| Project name | | | |

FUJISJ FUJI ELEVATOR CO.,LTD 富士电梯有限公司